
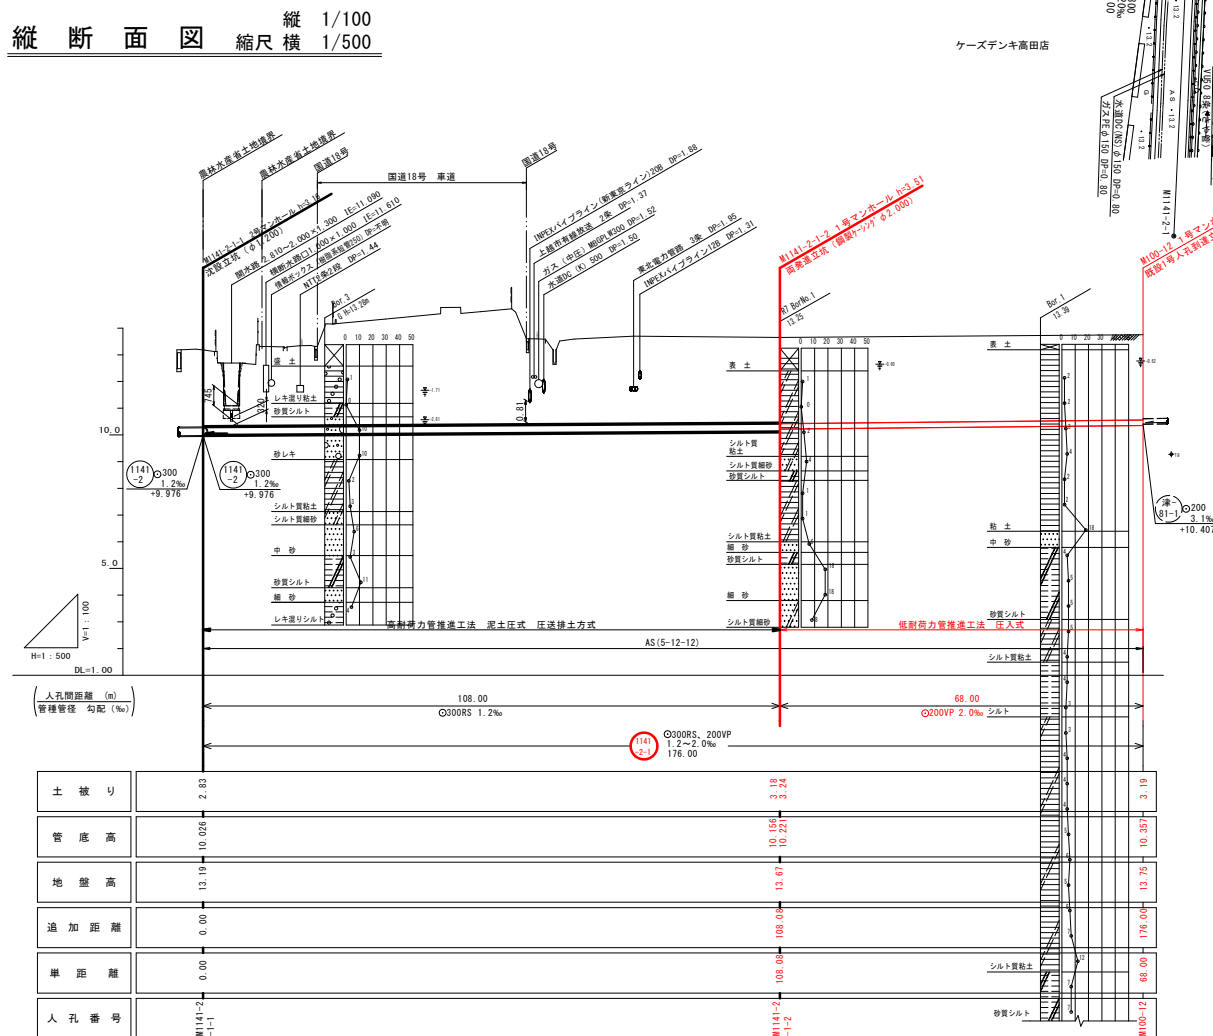
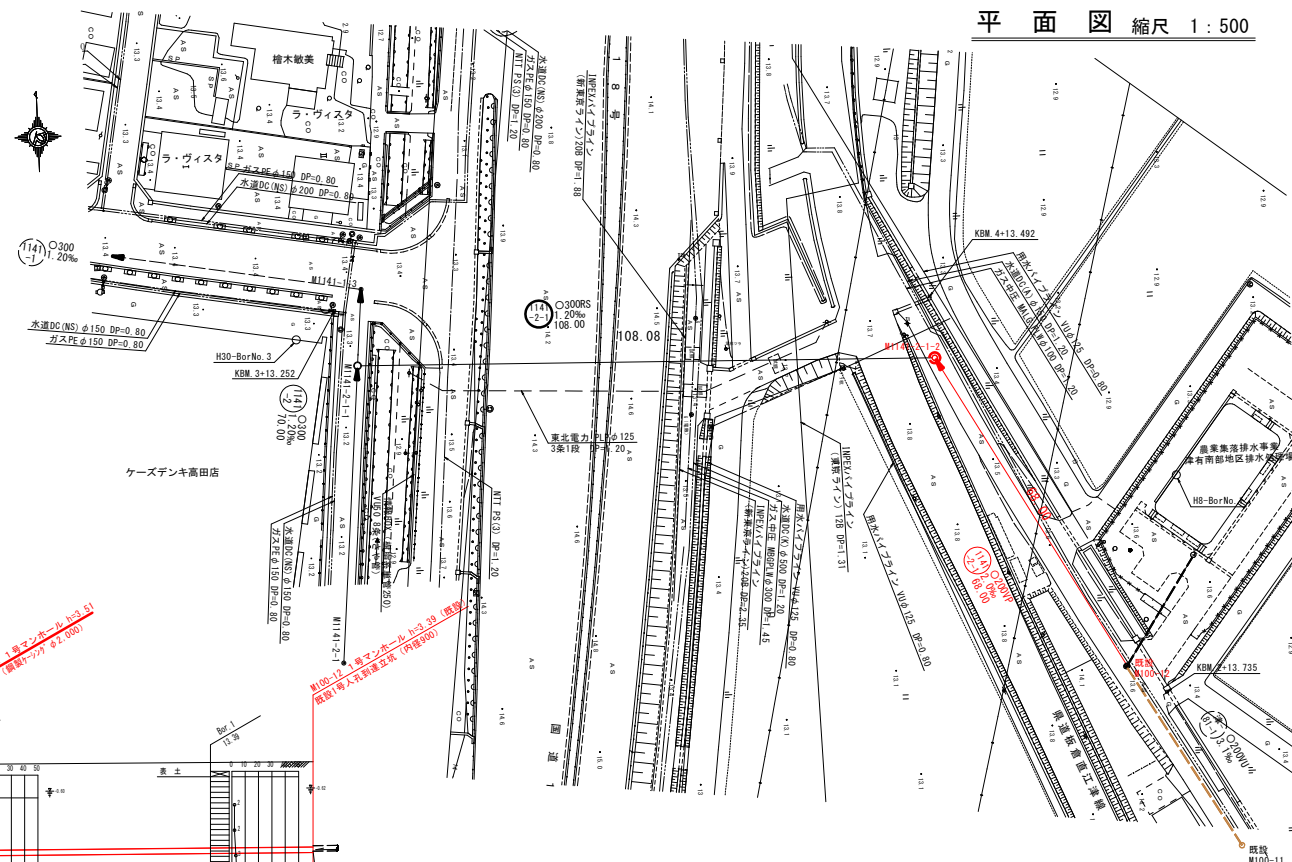


縦断面図 縦縮尺 1/100
横縮尺 1/500

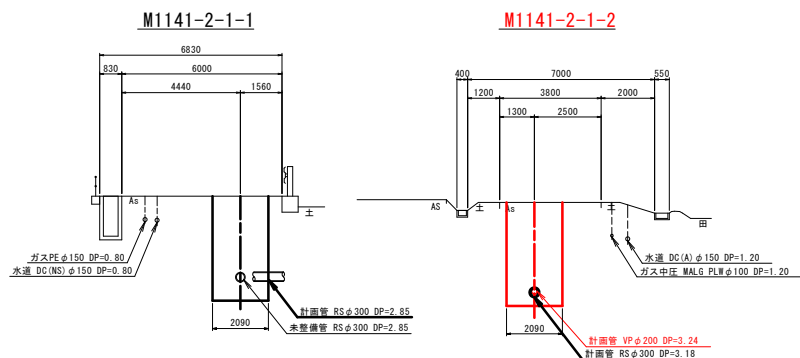

点 名	X座標	Y座標	Z座標
T1	122495.061	-19581.405	13.626
T2	122385.694	-19546.917	13.951
T3	122343.042	-19639.939	13.228
T4	122283.177	-19551.740	13.372
T5	122222.022	-19664.699	12.928
T6	122234.322	-19716.566	12.938
T7	122294.183	-19700.958	12.904
T8	122395.087	-19691.801	12.967
T2A	122368.848	-19622.889	14.650
KDM.2	122424.192	-19535.857	13.735
KDM.3	122501.835	-19688.510	12.252

点 名	X座標	Y座標	Z座標
M1141-2-1	122435.888	-19689.451	13.056
M1141-1-3	122505.659	-19683.338	13.207
既設M100-12	122429.333	-19542.924	13.745

新設マンホール点座標一覧

点 名	X座標	Y座標	Z座標
M1141-2-1-1	122492.908	-19684.455	13.179
M1141-2-1-2	122488.438	-19576.548	13.655

Z座標値は直轄水準による

路線番号

1141					
-2-1					

工事番号	公汚連 第8-1号	図面番号	1
工事名	津有南部汚水連携管渠工事		
施工地名	上越市 下新町他 地内		
図面名	平面・縦断面・横断面図		
縮尺	図示		
上越市ガス水道局			

M1141-2-1-2 発進立坑仮設図・マンホール図

[illegible]

鋼製ケーシング
呼び径φ2000

1141
2-1

12

2,066 (D2)

2,090 (D1)

12°

12°

円形覆工板
呼び径φ2000

2500

2.066 (D2)

820

600

110

(t=110)

調整リングh=100

調整ブロック
(900×600×150)

直壁ブロック
(900×1,800)

躯体ブロック
(900×1,200)

底板ブロック

調整コンクリート

18.8 / DDP

高気密性無収縮早強モルタル

発火放射防止調整金具
調整高さh=34mm

1141
-2-1

▽+10.156

360

30

300

300

850

980

1,650

1141
-2-1

▽+10.221

410

200


116

Technical drawing of a foundation cross-section. The drawing includes the following details:


- Dimensions:**
 - Overall width: 2,090 (D1)
 - Inner width: 2,066 (D2)
 - Reinforcement cage height (H8): 4,500
 - Front cage height: 2,400
 - Final cage height: 2,100
 - Reinforcement cage height: 2,000
 - Vertical distance between reinforcement cages: 1,076
 - Vertical distance from reinforcement cage to top: 924
 - Vertical distance from reinforcement cage to bottom: 400
 - Vertical distance from reinforcement cage to bottom: 424
 - Vertical distance from reinforcement cage to bottom: 550
 - Vertical distance from reinforcement cage to bottom: 200
- Labels and Notes:**
 - ボルト接合 (Bolt joint)
 - 溶接接合 (Welded joint)
 - 掘削深 5,224 (Excavation depth 5,224)
 - 圧入深 5,424 (Penetration depth 5,424)
 - GL+13.67
 - 土 (Soil)
 - 粘性土 N ≤ 5 (Clayey soil N ≤ 5)
 - シルト質粘土 (Silt clay)
 - 粘性土 砂質土 N ≤ 50 (Clayey soil, silty soil N ≤ 50)
 - シルト質細砂 (Silt fine sand)
 - 砂質シルト (Silty sand)
 - 覆工板 (H5) (Reinforcement plate (H5))
 - 67 No. 1 6 H13 300
- Scale:** 0 10 20 30 40 50

工事番号	公汚連 第8-1号	図面番号	2
工 事 名	津有南部汚水連携管渠工事		
施工地名	上越市 下新町他 地内		
図 面 名	発達立坑仮設図・マンホール図		
縮 尺	S=1:30		
上越市ガス水道局			


平面図

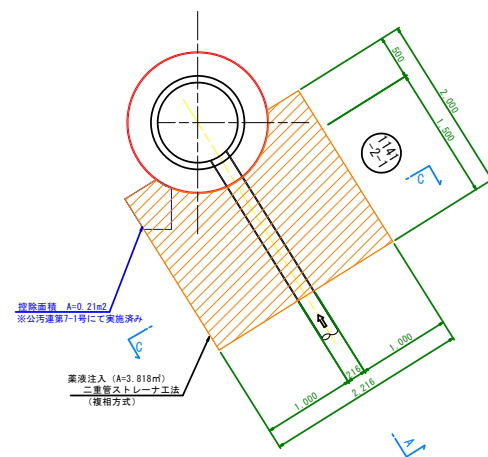

A-A断面図

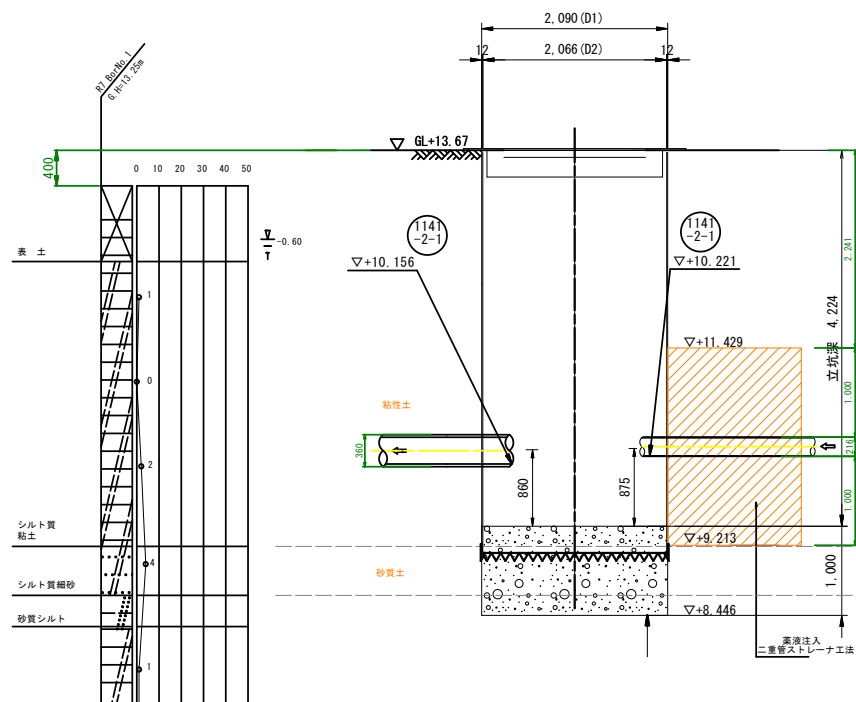


C-C断面図

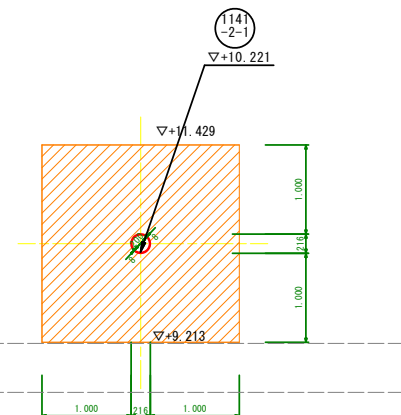


工 事 番 号	公汚道 第8-1号	図面番号	3
工 事 名	津有南部汚水運搬管渠工事		
施 工 地 名	上越市 大字新町地 地内		
図 面 名	薬液注入工図		
縮 尺	図 示		
上越市ガス水道局			


縮尺 1:30



A-A断面図



B-B断面図



上越市ガス水道局